



XMM - OM - IMAGING - Filename: product/P0410780801OMS015SPECTR0000.FIT
- Obs ID: 0410780801 - Exp ID: 0410780801015 - Filter: GRISM1 (UV)
Spec.No: 1 - ID: 001 - RA: 194.2595835 - DEC: 22.0311111 - XY= [233, 55] - Object: DEFAULT EXTRACTION
Start: 2011-06-25T10:19:15.000 - Stop: 2011-06-25T10:36:03.000 - Exp.time: 1000 secs

OM GRISM SPECTRA, BACKGROUND SUBTRACTED - Mean value=0.04713588 - Aver.Err.= 3.05358×10^{-3}

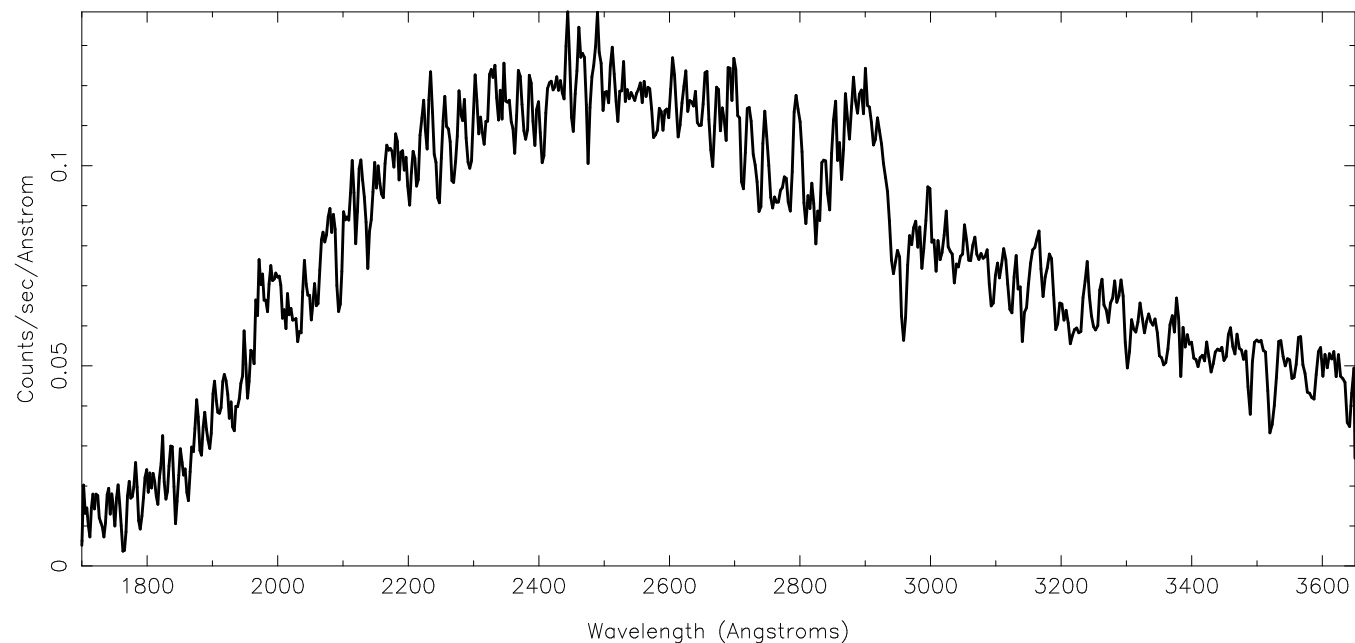

BACKGROUND RATES - Mean value= 3.69889×10^{-3} - Aver.Err.= 8.8176×10^{-4}

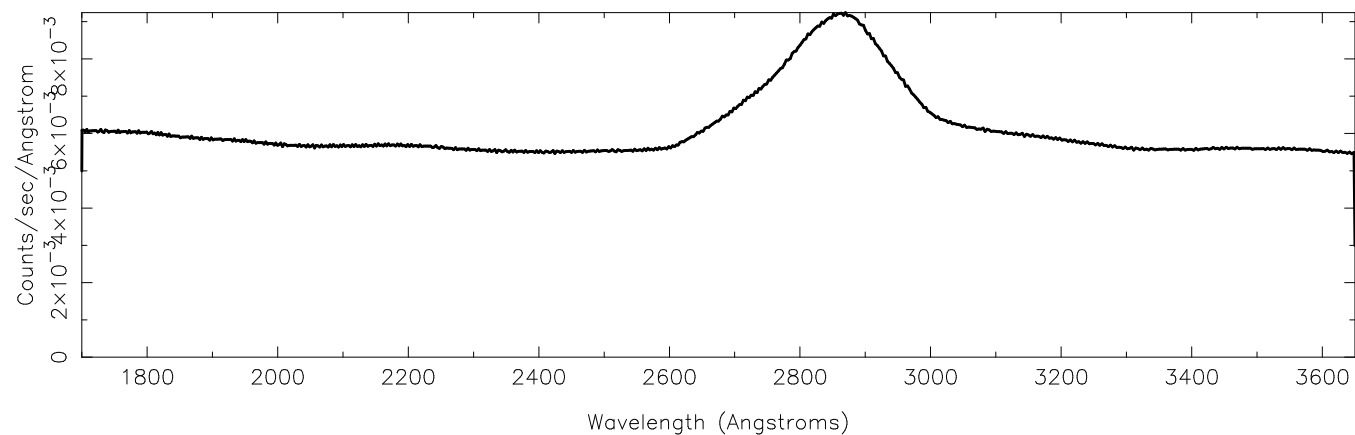

XMM - OM - IMAGING - Filename: product/P0410780801OMS015SPECTR0000.FIT
- Obs ID: 0410780801 - Exp ID: 0410780801015 - Filter: GRISM1 (UV)
Spec.No: 1 - ID: 001 - RA: 194.2595835 - DEC: 22.0311111 - XY= [233, 55] - Object: DEFAULT EXTRACTION
Start: 2011-06-25T10:19:15.000 - Stop: 2011-06-25T10:36:03.000 - Exp.time: 1000 secs

FLUX, BACKGROUND SUBTRACTED - Mean value= $1.57560895 \times 10^{-13}$ - Aver.Err.= $1.50887823 \times 10^{-14}$

Time dependent sensitivity correction=1.070

