



XMM - OM - IMAGING - Filename: product/P0410780801OMS015SPECTR0000.FIT  
- Obs ID: 0410780801 - Exp ID: 0410780801015 - Filter: GRISM1 (UV)  
Spec.No: 1 - ID: 001 - RA: 194.2595835 - DEC: 22.0311111 - XY= [ 233, 55] - Object: DEFAULT EXTRACTION  
Start: 2011-06-25T10:19:15.000 - Stop: 2011-06-25T10:36:03.000 - Exp.time: 1000 secs

OM GRISM SPECTRA, BACKGROUND SUBTRACTED - Mean value=0.04713588 - Aver.Err.= $3.05358 \times 10^{-3}$

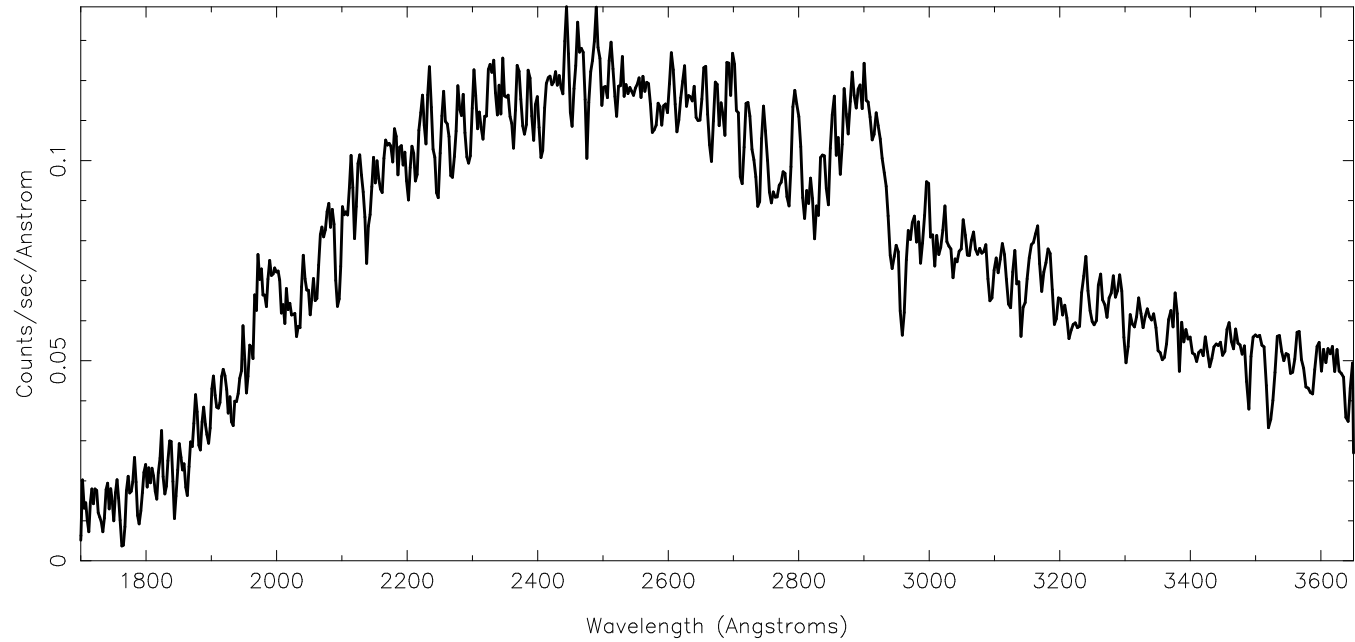

BACKGROUND RATES - Mean value= $3.69889 \times 10^{-3}$  - Aver.Err.= $8.8176 \times 10^{-4}$

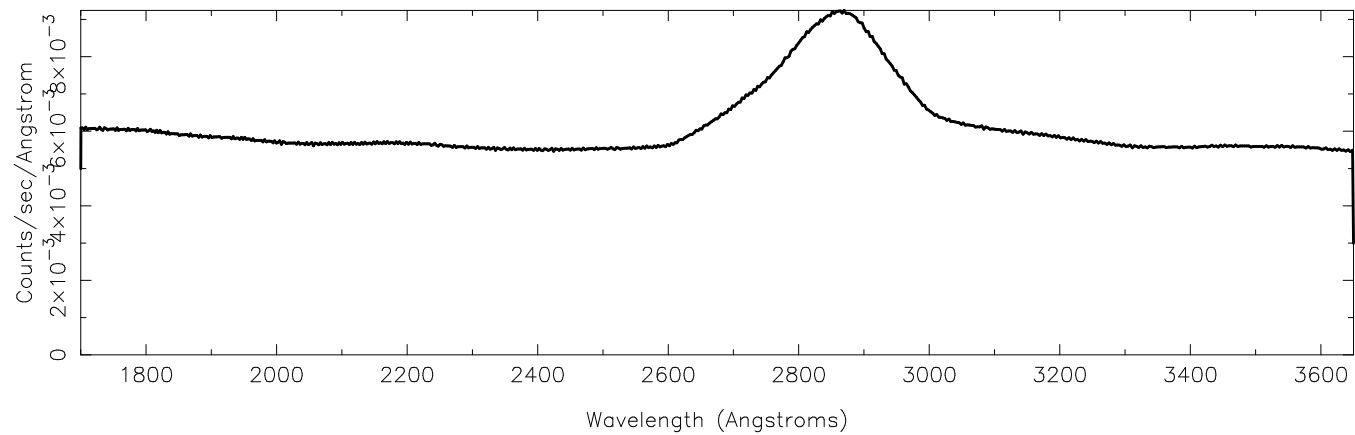

XMM - OM - IMAGING - Filename: product/P0410780801OMS015SPECTR0000.FIT  
- Obs ID: 0410780801 - Exp ID: 0410780801015 - Filter: GRISM1 (UV)  
Spec.No: 1 - ID: 001 - RA: 194.2595835 - DEC: 22.0311111 - XY= [ 233, 55] - Object: DEFAULT EXTRACTION  
Start: 2011-06-25T10:19:15.000 - Stop: 2011-06-25T10:36:03.000 - Exp.time: 1000 secs

FLUX, BACKGROUND SUBTRACTED - Mean value=  $1.58707127\text{E-}13$  - Aver.Err.=  $1.51985409\text{E-}14$

Time dependent sensitivity correction=1.077

