



XMM - OM - IMAGING - Filename: product/P0830800901OMS015SPECTR0000.FIT  
- Obs ID: 0830800901 - Exp ID: 0830800901015 - Filter: GRISM1 (UV)  
Spec.No: 1 - ID: 001 - RA: 194.2595835 - DEC: 22.0302778 - XY= [ 251, 44]  
Start: 2024-07-18T01:53:17.000 - Stop: 2024-07-18T02:10:00.000 - Exp.time: 1000 secs

OM GRISM SPECTRA, BACKGROUND SUBTRACTED - Mean value=0.04731583 - Aver.Err.= $3.21913 \times 10^{-3}$

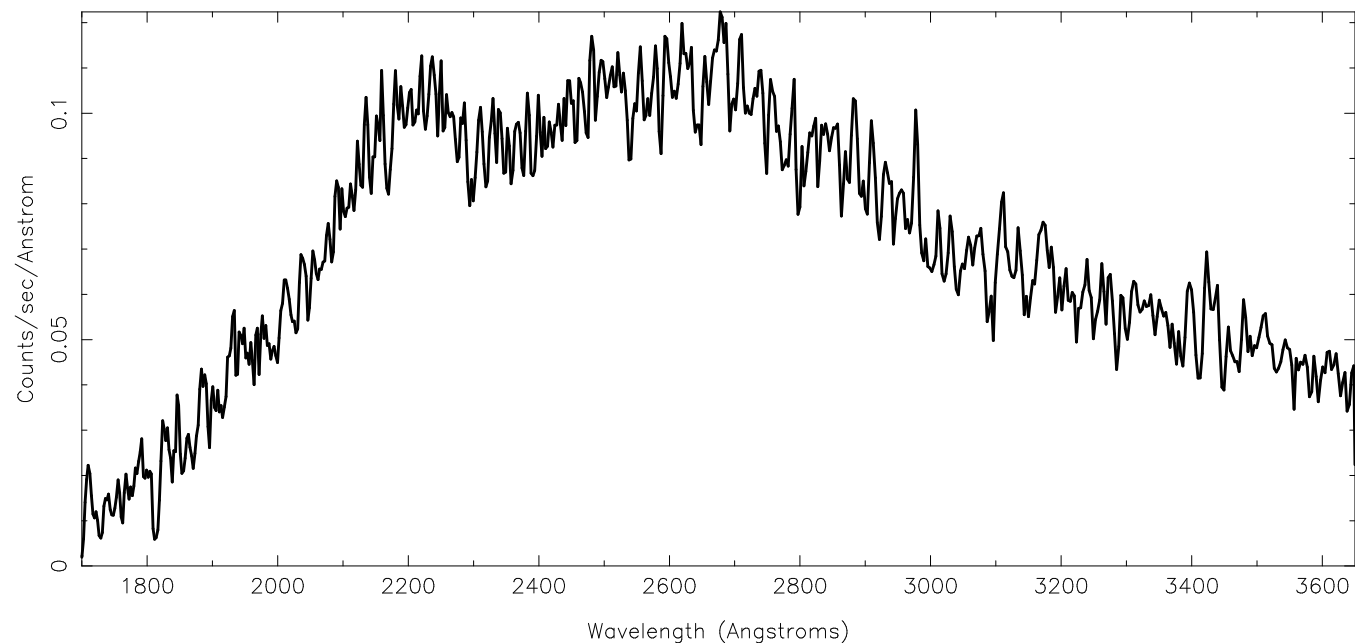

BACKGROUND RATES - Mean value= $4.28393 \times 10^{-3}$  - Aver.Err.= $9.9781 \times 10^{-4}$

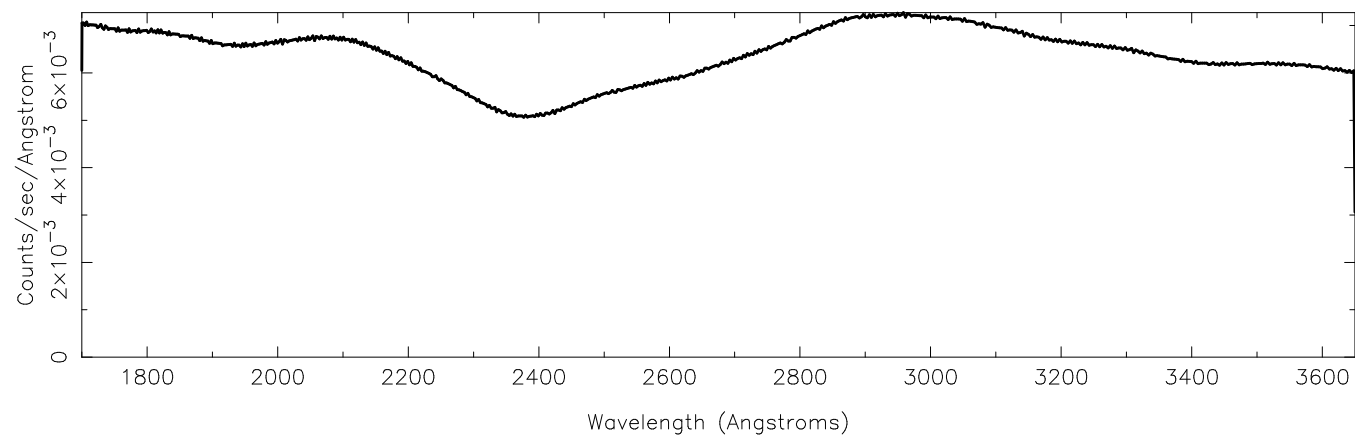

XMM - OM - IMAGING - Filename: product/P0830800901OMS015SPECTR0000.FIT  
- Obs ID: 0830800901 - Exp ID: 0830800901015 - Filter: GRISM1 (UV)  
Spec.No: 1 - ID: 001 - RA: 194.2595835 - DEC: 22.0302778 - XY= [ 251, 44]  
Start: 2024-07-18T01:53:17.000 - Stop: 2024-07-18T02:10:00.000 - Exp.time: 1000 secs

FLUX, BACKGROUND SUBTRACTED - Mean value=  $1.73820105\text{E-}13$  - Aver.Err.=  $1.70927878\text{E-}14$   
Time dependent sensitivity correction=1.161

